


LOCATION OF UTILITIES ARE APPROXIMATE AND SHOULD BE VERIFIED BY CONTRACTOR IN FIELD.

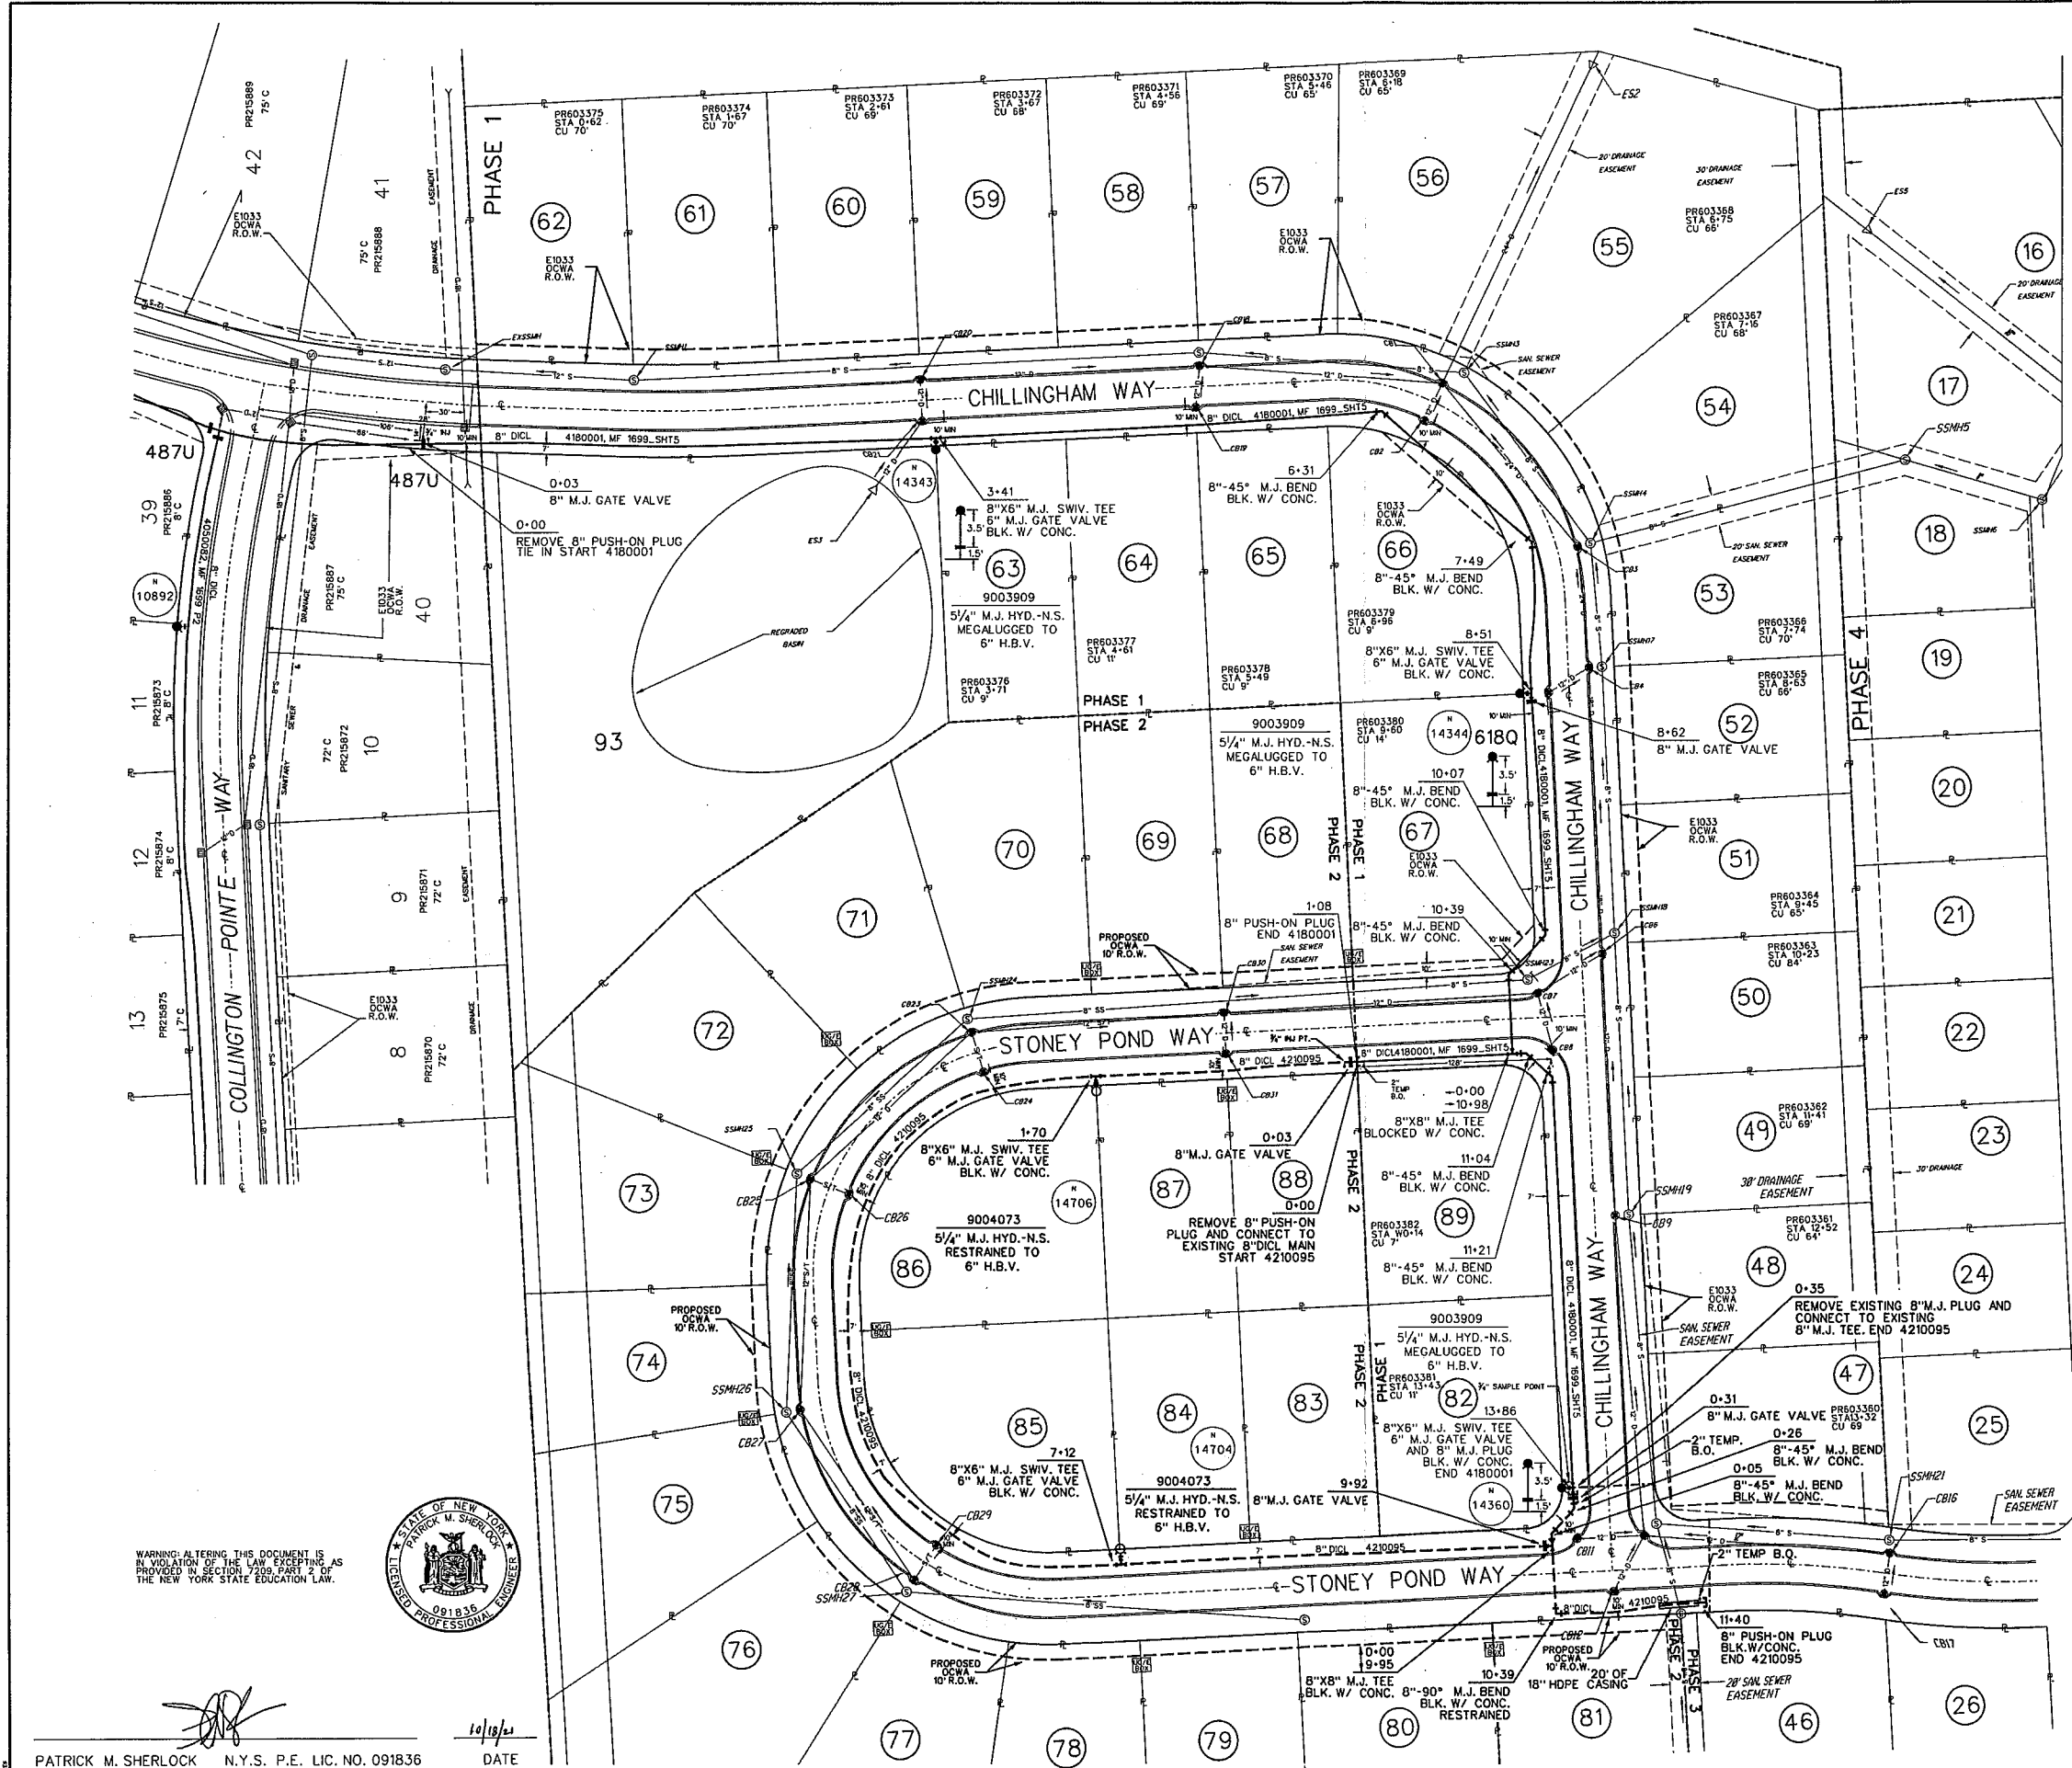

PRESSURE CHECK

SUPPLY TKN HEADST - 60'	SUPPLY TKN HEADST - 60'
GROUND ELEV. (HIGHEST) - 400'	GROUND ELEV. (HIGHEST) - 400'
FEET OF HEAD - 100'	FEET OF HEAD - 100'
HIGHEST PRESSURE - 84 PSI	LOWEST PRESSURE - 50 PSI

LEGEND

- EXISTING WATER MAINS & HYDRANTS
- WATER MAINS & HYDRANTS INSTALLED UNDER 4210095, 9004073
- HYDRANT THREAD CODE 9999
- GATE VALVE
- WATER SERVICE & CURB BOX
- STORM SEWER W/ CATCH BASINS
- SANITARY SEWER W/ MANHOLES
- GAS MAIN
- UNDERGROUND ELECTRIC CABLE
- UNDERGROUND TELEPHONE CABLE
- SEWER FORCE MAIN
- MONUMENT, PROPERTY LINE, POINT OF TANGENT & IRON PIPE
- CENTERLINE OF ROAD

Hyd. Letter

ALL POLYWRAPPED
DESIGN DRAWING
 THIS DRAWING IS INTENDED FOR CONSTRUCTION.
 SEE RECORD DRAWING WHEN COMPLETE.
 FOR AS BUILT INFORMATION.

SHEET 5

0505 - COLD SPRINGS WSD '400' Pg. 41-09

REVISION	DATE	BY
PLAN APPROVED	4/5/18	PHS
AS BUILT	4/20/01	SDW
PLAN APPROVED	10/16/21	

OCWA
 NORTHERN CONCOURSE PO BOX 4949 SYRACUSE, NY 13211

8" EXTENSION
COPPER RIVER
 PHASE 2
 TOWN OF LYSANDER

DESIGN JAK	SCALE 1" = 50'	MAP FILE 1699
DRAWN JAK	FILE No. 4180001 4210095	TRACT MAP 228
CHECKED SJD	9003909 9004073	
DATE 10/06/2021		

WARNING: ALTERING THIS DOCUMENT IS IN VIOLATION OF THE LAW EXCEPTING AS PROVIDED IN SECTION 7209, PART 2 OF THE NEW YORK STATE EDUCATION LAW.



PATRICK M. SHERLOCK N.Y.S. P.E. LIC. NO. 091836 DATE 10/18/21